


NOTE:

1. A HOLE SAW OF THE DIAMETER SPECIFIED BY THE MANUFACTURER SHALL BE USED FOR ALL INSERTA TEE INSTALLATIONS. THE TEE AND BEND SHALL BE CONCRETE ENCASED AS PER THE SANITARY SEWER ENCASEMENT DETAIL. THE FULL LENGTH OF THE SERVICE DITCH SHALL BE FILLED IN 6" LIFTS USING MECHANICAL COMPACTION EQUIPMENT. PIPE SHALL BE BEDDED IN WASHED ROCK PER SECTION 02320.
2. SEWER CLEAN OUT MUST BE INSTALLED INSIDE A VALVE BOX WITH COVER LABELED "SEWER".

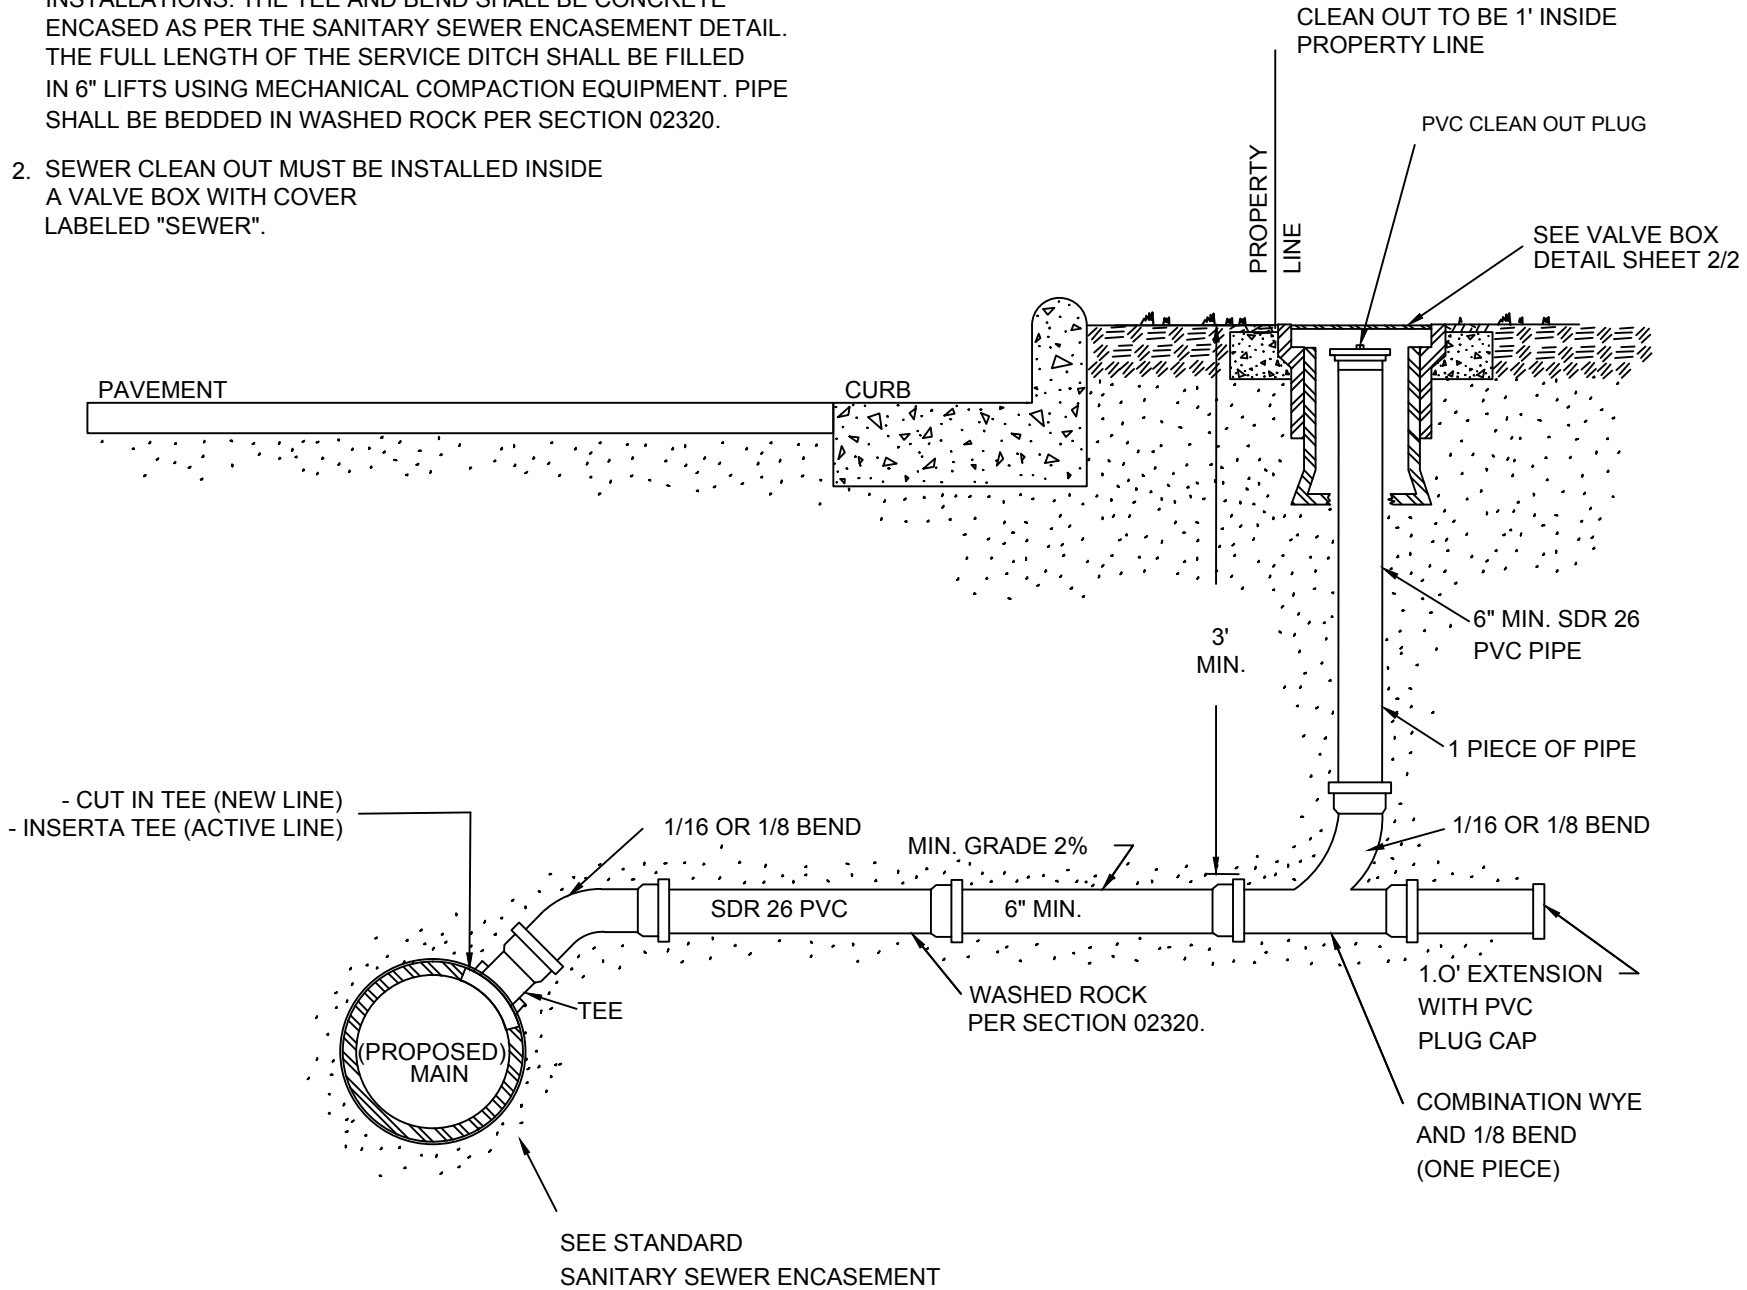

SANITARY SEWER LATERAL

TECHNICAL SPECIFICATION SECTION 02085

ENGINEERING AND PUBLIC WORKS	SCALE: N.T.S.	DATE: 5/10/19
	DGN BY: ENG.	DRAWN BY: BCP
		SHEET NO.: 1

