


**\*\*NOTE\*\***  
 METER BOXES WILL BE ACCOMPANIED BY AN "X"  
 ETCHED INTO CURB FACE PAINTED BLUE

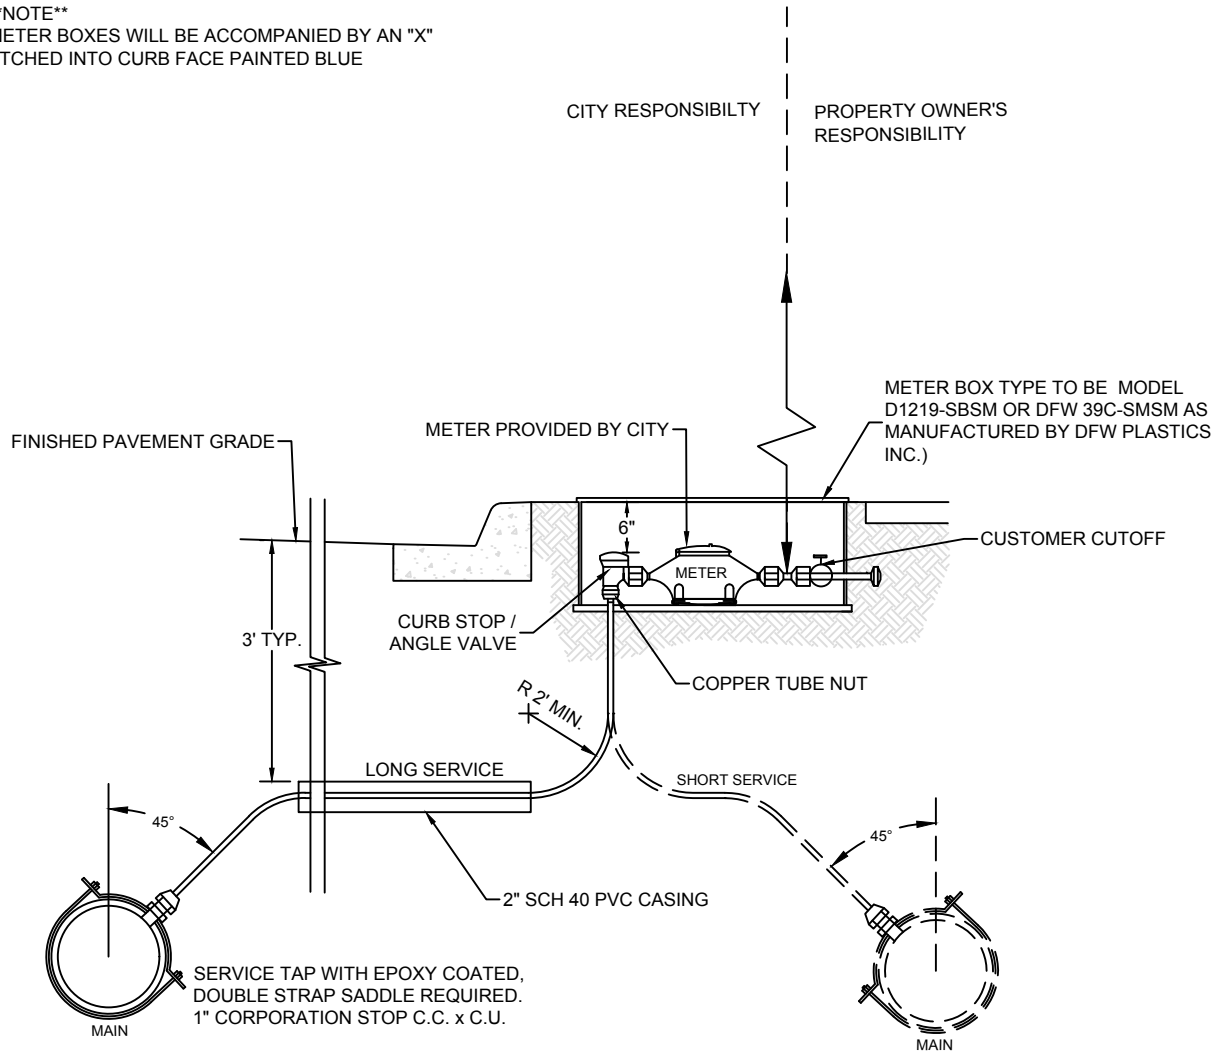

NOTE:  
 ALL SERVICES ARE TYPE "K" COPPER

NOTE:

CONTRACTORS SHOULD USE HTH FOR DISINFECTION OF WATER LINES (NOT CHLORINE INJECTION) UNLESS APPROVED OTHERWISE PRIOR TO ISSUANCE OF PERMIT.

NEW WATERLINES SHALL BE TIED INTO EXISTING WATER SYSTEM UNDER THE SUPERVISION OF CITY PERSONNEL NO LATER THAN 14 DAYS AFTER PASSING BACTERIOLOGICAL TESTS.



**CITY OF SCHERTZ TEXAS**  
 ENGINEERING AND PUBLIC WORKS

**WATER TAP & SERVICE**

STANDARD DETAIL  
 N.T.S.

PW TECH. SPEC. SECTION 02512

SHEETNUMBER	PROJECT NO.:	DATE: 2/26/18
DRWN. BY: BCP	DSGN. BY: BCP	CHKD. BY: KJW
		SHEET NO.: 1 of 1