



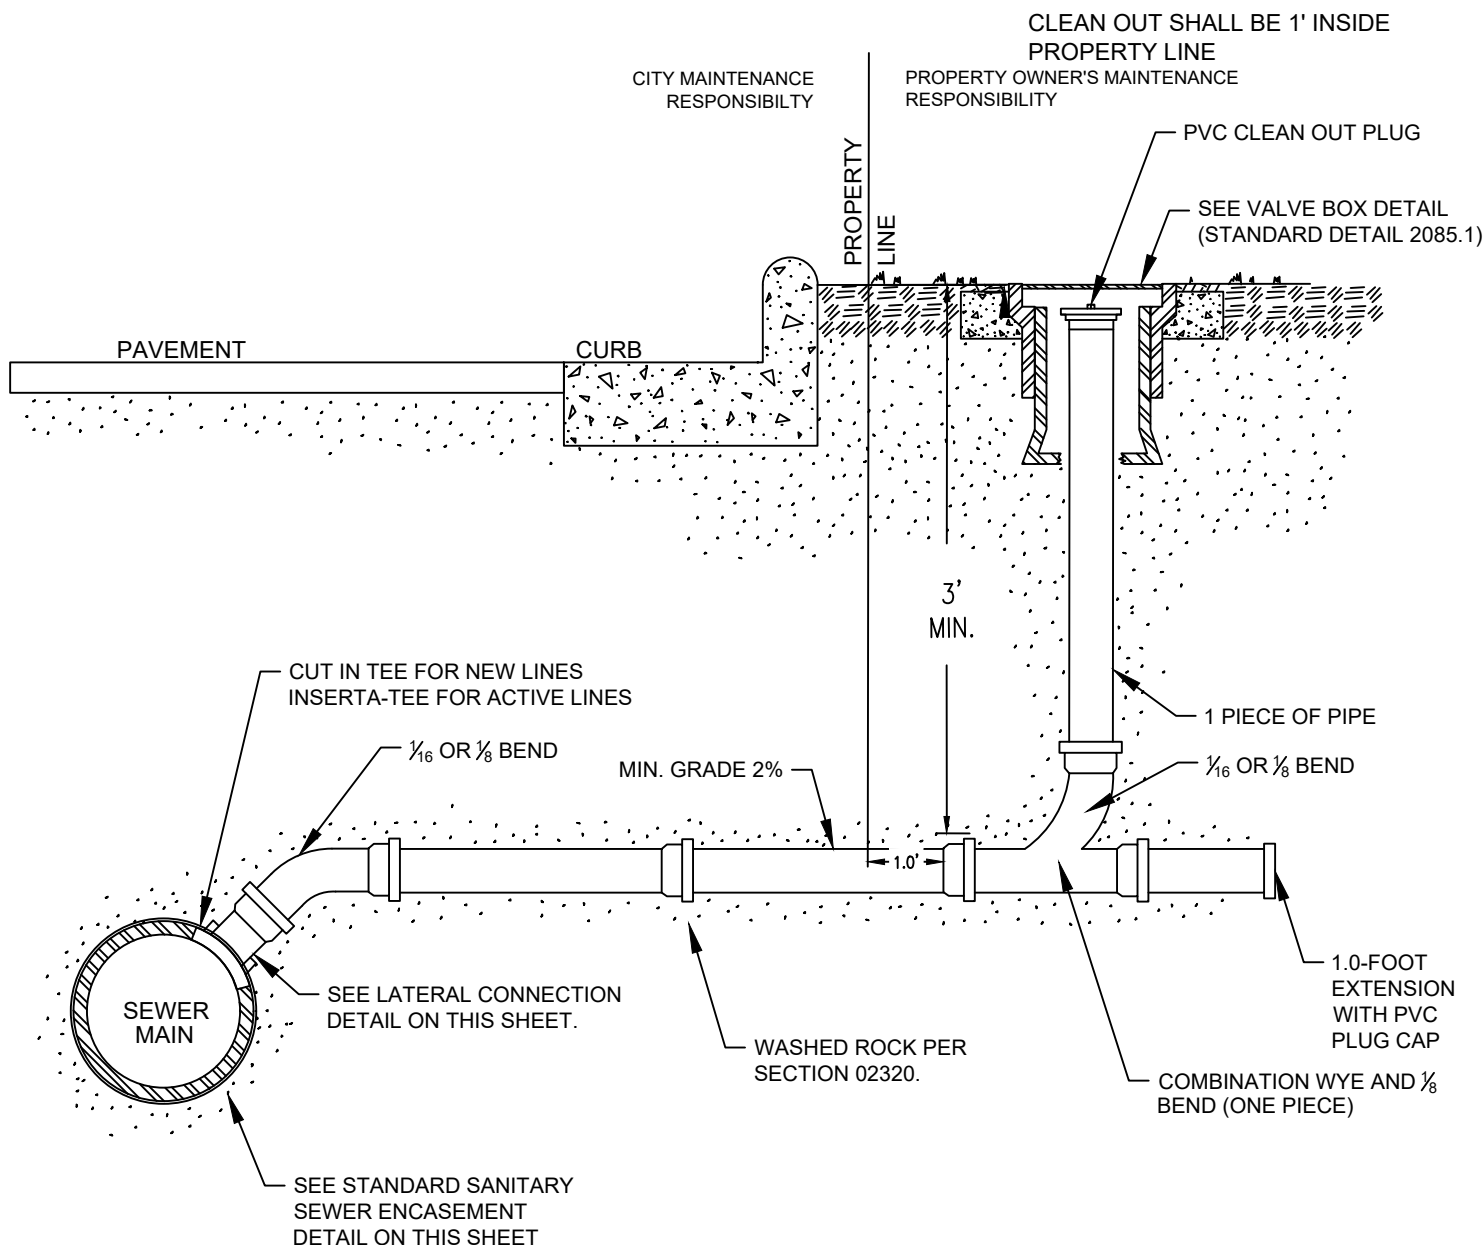

NOTES:

1. A HOLE SAW OF THE DIAMETER SPECIFIED BY THE MANUFACTURER SHALL BE USED FOR ALL INSERTA TEE INSTALLATIONS. THE TEE AND BEND SHALL BE CONCRETE ENCASED AS PER THE SANITARY SEWER ENCASEMENT DETAIL THE FULL LENGTH OF THE SERVICE DITCH SHALL BE FILLED IN 6-INCH LIFTS USING MECHANICAL COMPACTION EQUIPMENT. PIPE SHALL BE BEDDED IN WASHED ROCK PER SECTION 02320.
2. ALL SEWER MAINS WITH LESS THAN 4' OR COVER TO FINAL GRADE SHALL BE CONCRETE ENCASED.
3. SEWER CLEANOUT MUST BE INSTALLED INSIDE A VALVE BOX WITH COVER LABELED "SEWER."
4. SEWER LATERAL PIPE SHALL BE 6" MINIMUM SDR 26 PVC PIPE.
5. CONCRETE ENCASEMENT TO BE 6" GREATER THAN THE FULL LENGTH OF TEE IN ALL DIRECTIONS AROUND PIPE.

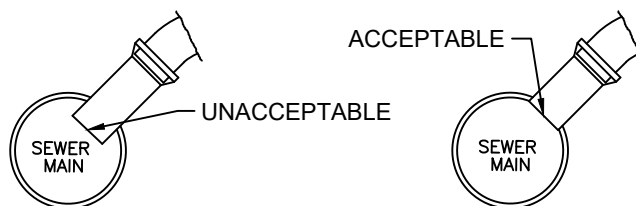

LATERAL CONNECTION DETAIL